


NOTE:

- 1.) ALL FIRE HYDRANT LEADS TO BE DUCTILE IRON WITH MECHANICAL JOINTS. HYDRANTS TO BE LOCATED 3' TO 10' BEHIND EDGE OF PAVEMENT OR 1' INSIDE RIGHT-OF-WAY AND ON PROPERTY LINE BETWEEN TWO LOTS. VERIFY LOCATION W/ HILTON HEAD NO. 1 PSD. HYDRANT SHALL NOT BE WITHIN 10' OF SEWER SYSTEM.
- 2.) ALL FITTINGS SHALL BE MECHANICAL JOINTS AT TEES, GATE VALVES & FIRE HYDRANTS.
- 3.) REFER TO THE WATER DISTRIBUTION SYSTEM SPECIFICATIONS FOR ACCEPTABLE MANUFACTURERS.

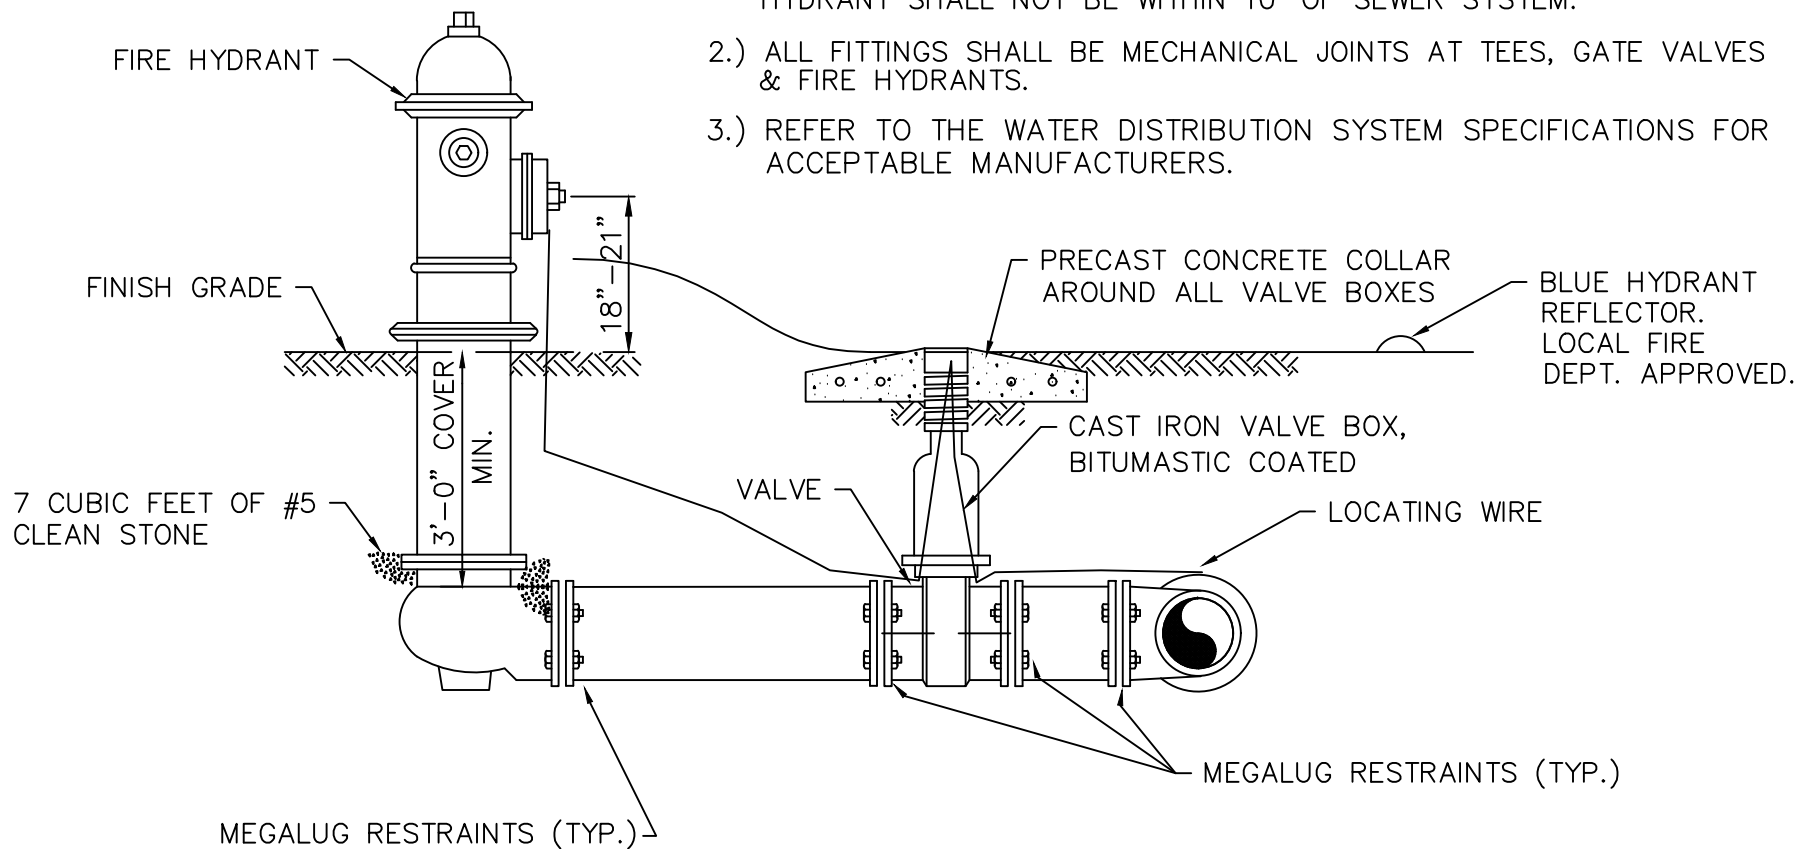

FIRE HYDRANT, VALVE & TEE SETTING  
NOT TO SCALE

HILTON HEAD NO. 1 PUBLIC SERVICE DISTRICT		
FIRE HYDRANT, VALVE & TEE SETTING		
APPROVED BY: LC	DATE: Feb. 1997	DRAWING NO.  VIII-2
SCALE: NTS	REVISED: Jan. 2024	