


NOTE:

- 1.) REFER TO THE WATER DISTRIBUTION SYSTEM SPECIFICATIONS FOR ACCEPTABLE MANUFACTURERS.
- 2.) GATE VALVES SHALL BE UTILIZED ON LINES GREATER THAN 2".

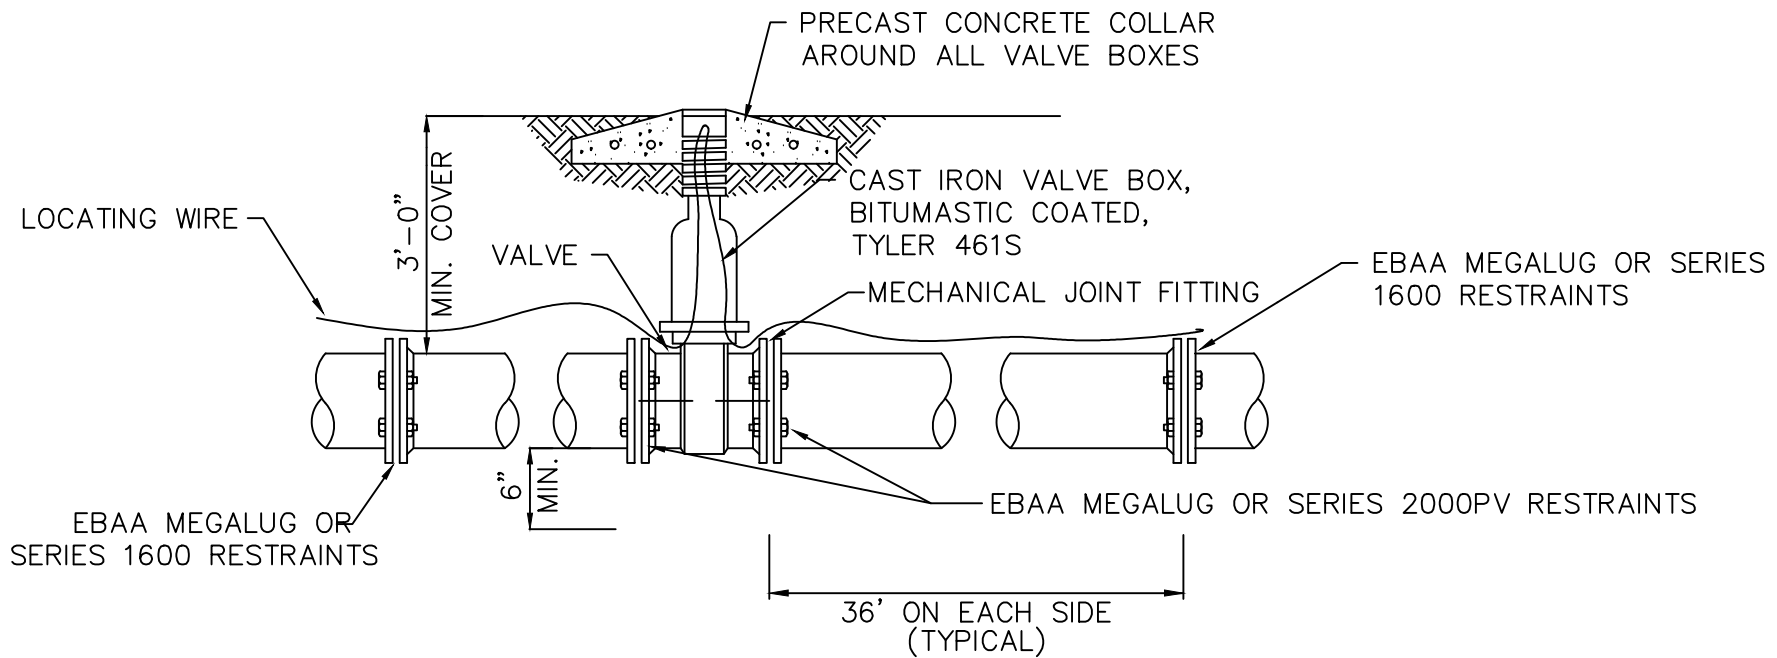

GATE VALVE SETTING DETAIL
NOT TO SCALE

HILTON HEAD NO. 1
PUBLIC SERVICE DISTRICT

GATE VALVE SETTING DETAIL

APPROVED BY:
LC

DATE:
Feb. 1997

DRAWING NO.

SCALE:
NTS

REVISED:
Jan. 2024

VIII-3