



NOTE:

- 1.) ALL FITTINGS SHALL BE MECHANICAL JOINTS.
- 2.) TRACER WIRE SHALL BE LOOPED TO THE TOP OF THE VALVE BOX.
- 3.) REFER TO THE WATER DISTRIBUTION SYSTEM SPECIFICATIONS FOR ACCEPTABLE MANUFACTURERS.

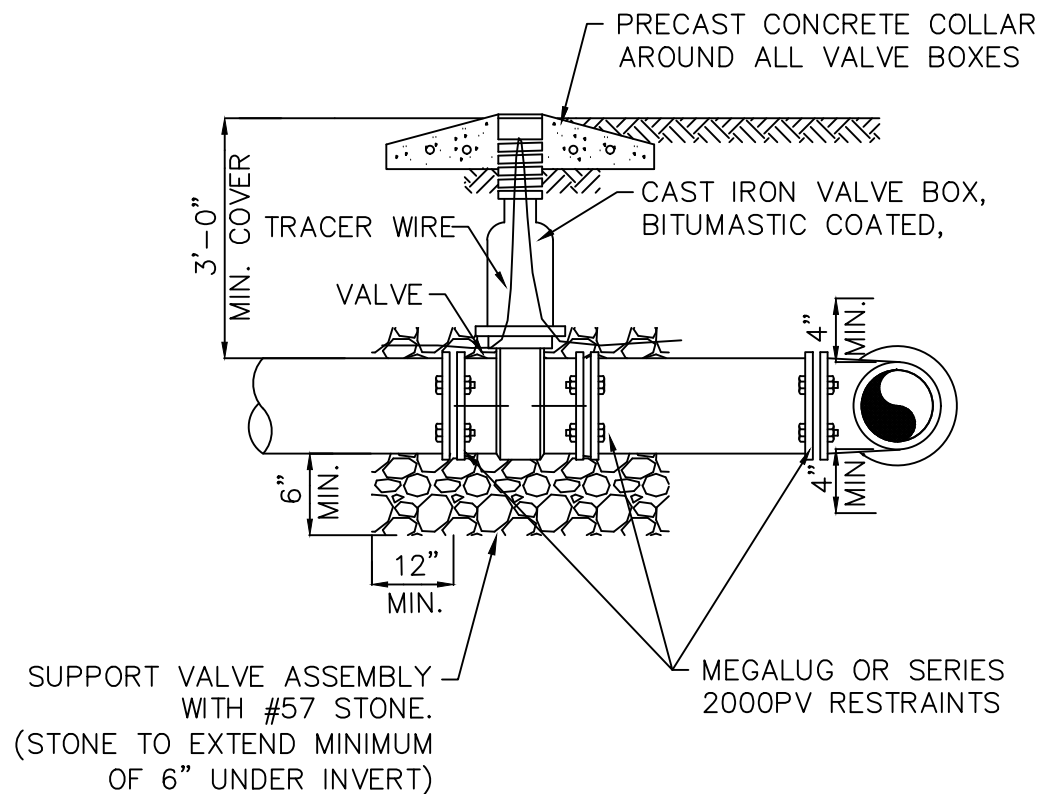

VALVE & TEE SETTING DETAIL
NOT TO SCALE

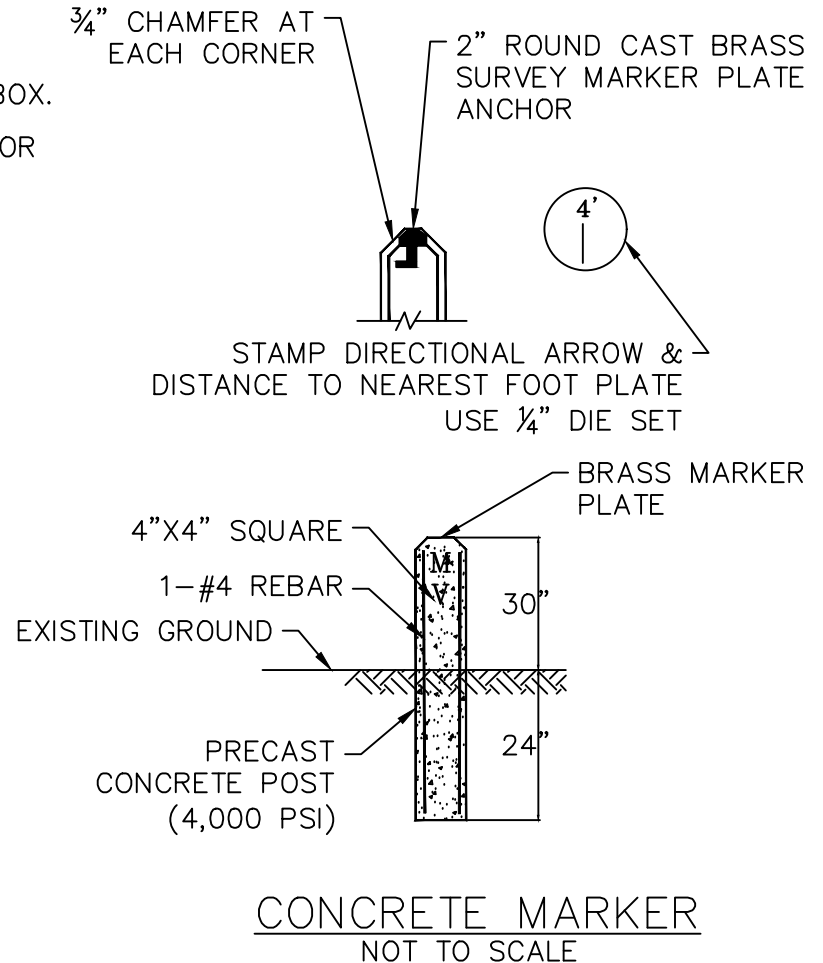

HILTON HEAD NO. 1
PUBLIC SERVICE DISTRICT

VALVE & TEE SETTING DETAIL

APPROVED BY: LC	DATE: Feb. 1997	DRAWING NO. VIII-4
SCALE: NTS	REVISED: Jan. 2024	